

### Overview

BAPI's voltage converter is a cost-effective way of converting 24 VAC or VDC to 5, 12, 15 or 5 to 24 VDC for use on peripheral devices that require DC voltage. The converter is available with a 350 mA output.

The BA/VC350A can be mounted in 2.75" snaptrack or with the high bonding tape on the bottom of the unit. The BA/VC350A-EZ with its revolutionary EZ mounting system allows for 2.75" snaptrack, DIN rail or surface mounting.

Although most BAPI room units can run on 24 VAC power, converting to DC power eliminates the AC power "noise" which can affect the room sensor readings. BAPI's tests show that fluctuating and inaccurate signal levels are possible when AC power wiring is present in the same cable as the signal lines. To minimize the AC voltage noise, the DC converter must be mounted as close to the controller as physically possible. Do not mount the converter at the sensor end of the wire, the AC will still couple into the sensor signal if you do. All fixed outputs of 5, 10, 12 or 15 VDC are adjustable  $\pm 10\%$ . The adjustable model (-ADJ) has an output of 5-24 VDC

### Product Identification

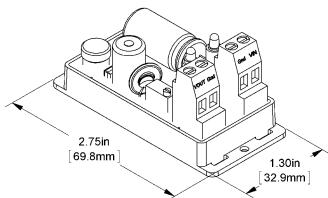


Figure 1: BA/VC350A in Snap Track Mount



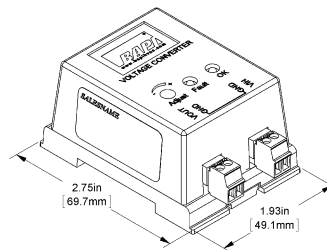


Figure 2: BA/VC350A-EZ in EZ-Mount



### Specifications

**Output Voltage:** 5 to 24 VDC @ 350 mA

**Recommended Input Voltage:** 18-28 VAC, 24 VDC

**Input Voltage Limits:**

Model	MIN (VAC/VDC)	MAX (VAC/VDC)	Power Consumption @Min Input Volts(AC/DC)
5V	5.0/9.0	28.0/35.0	5.2 VA/305 mA
10V	10.0/14.7	28.0/35.0	8.3 VA/315 mA
12V	12.0/16.9	28.0/35.0	9.5 VA/318 mA
15V	15.0/20.5	28.0/35.0	11.2 VA/320 mA
ADJ (5 to 24V)	24.0/31.0*	28.0/35.0	16.7 VA/325 mA

\*Depends on output voltage

**Environmental Operation Range:**

-40°F to 149°F (-40°C to 65°C) 350 mA @ any output voltage

149°F to 158°F (65°C to 70°C) 350 mA @ 5 VDC, 330 mA @ 10 VDC, 280 mA @ 12 VDC,

224 mA @ 15 VDC & 140 mA @ 24 VDC

0 to 95% RH non-condensing

**Environmental Storage Range:** -40°F to 176°F (-40°C to 80°C)

**Wiring:** 4-wires, 16 to 22 gauge (All wiring must comply with the National Electric Code [NEC] and local codes)

**Rectification:** Half-Wave Rectified

**Grounding:** AC & DC Grounds are Common

**Material Rating:** EZ Plastic 94V-0

Specifications subject to change without notice.

### Mounting




This unit should be mounted at or within 2 feet of the control panel. DO NOT mount near or directly behind your room sensor.




The VC350 is intended to convert the AC power provided at the panel to DC. Tests show that fluctuating and inaccurate peripheral device signal levels are possible when AC power wiring is present in the same conduit as the signal lines.


### EZ-Mount




**Figure 3:** EZ-Mount on a DIN Rail



**Figure 4:** Catch EZ Mount hook on DIN rail before rotating sensor into place



**Figure 5:** EZ-Mount in Snaptrack

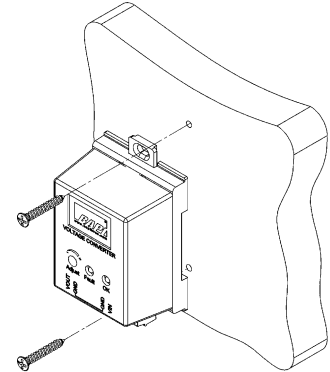

**Figure 6:** EZ-Mount Screwed to a Surface

### Mounting Tabs

The EZ Mount Base has mounting tabs that can be extended or pushed in. Figures 7 and 8 show the details.

#### Din Rail Mounting, Figure 3

- If not showing, pull the blue mounting tabs out as shown in Figure 8.
- Catch EZ mount hook on DIN rail as shown in Figure 4.
- Rotate the EZ pressure module down until the bottom mounting tab snaps into place on the DIN rail.

#### Snap Track Mounting, Figure 5

- If showing, push the blue mounting tabs in as shown in Figure 7.
- The edges of the EZ Mount base will fit into the board slots in 2.75 inch snap track.

#### Screwed to a Surface, Figure 6


- If not showing, pull the blue mounting tabs out as shown in Figure 8.
- Place the EZ Pressure unit against the surface and mark the screw holes.
- Drill 1/8" pilot holes for #8 flathead screws.
- Screw EZ Pressure unit to surface.

**Note:** The mounting holes in the blue mounting tabs are elongated to allow for alignment.


### Snap Track Mount

**Mounting with snaptrack:** Remove the VC350 from the snaptrack. Screw the snaptrack to the surface where you need to mount the unit. Replace the VC350 in the snaptrack.


**Mounting without snaptrack:** Peel the backing from the tape on the back of the unit and attach to the surface where you need to mount the unit.

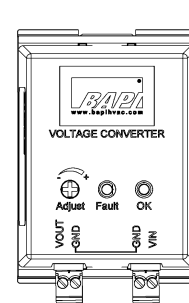

**Figure 7:** EZ-Mount with mounting tabs pushed in

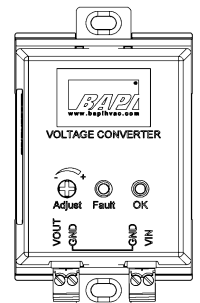


**Figure 8:** EZ-Mount with mounting tabs extended

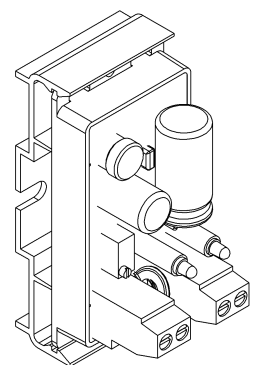


**Figure 9:** VC350A mounted in Snap Track

Specifications subject to change without notice.

### Wiring Termination




Prior to 1/23/2013



After 1/23/2013

**Figure 10: VC350A Wiring Terminals**

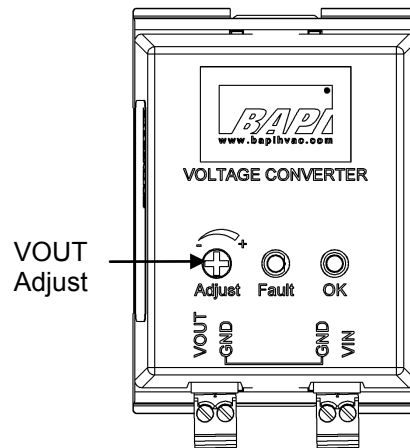

**Figure 11: VC350A-EZ Wiring terminals**


VC350A Terminal		VC350A-EZ Terminal	Function
Prior to 1/23/2013	After 1/23/2013		
1	VOUT	VOUT	VDC out to peripheral devices
2	GND	GND	VDC out ground or common
3	GND	GND	VAC or VDC input ground or common
4	VIN	VIN	VAC or VDC input from transformer or other power supply

**Note:** The terminals use a rising block screw terminal to hold the wires. It is possible for the block to be in a partially up position allowing the wire to be inserted under the block. Be sure that the connector screws are turned fully counterclockwise before inserting the wire. Lightly tug on each wire after tightening to verify proper termination.

### Diagnostics

Red or Fault	Green or OK	Condition	Solution
LED OFF	LED ON	Normal Operation	
LED ON	LED ON	Unstable condition, excessive load on the output	Reduce the output Load
LED OFF	LED OFF	No input power	Check for Proper Voltage
LED ON	LED OFF	Output shorted to Ground	Remove power, find and remove VDC short

**Note:** If the DC output voltage is lower than or higher than your limits, turn the VOUT Adjust until the output voltage is within limits.

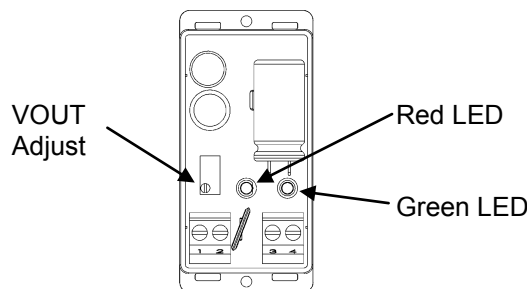

**Figure 12: VC350A showing LED positions and VOUT Adjust**

Specifications subject to change without notice.